ELCO Lighting
Innovation Beyond Expectation

Live End Connector & End Feed Kit
Track Accessory
EP801 & EP810
Installation Instructions


WARNING:
Risk of electric shock. Before installation, disconnect power to the luminaire. Failure to do so may result in electric shock and lead to injury or death.
Risque de choc électrique. Avant l'installation, débranchez l'alimentation au luminaire. Ne pas le faire peut entraîner un choc électrique et entraîner des blessures, voire la mort.

CAUTION:
For your safety, read and understand instructions completely prior to installation. Installation requires knowledge of luminaires electrical system. If not qualified, DO NOT attempt installation. Contact a qualified electrician if necessary.
Pour votre sécurité, lisez et comprenez entièrement les instructions avant l'installation. L'installation nécessite une connaissance du système électrique des luminaires. Si vous n'êtes pas qualifié, NE PAS tenter l'installation. Contactez un électricien qualifié si nécessaire.


NOTE: Before beginning the installation, carefully unpack and identify all parts. **Save these instructions as you may need them at a later date.**

Turn off switch at main power source before installing any track or fitting.

1. Remove live end cover from fitting. Place track attached over outlet box and mark on ceiling or wall the position of the track mounting holes.
2. Loosen set screw and insert connector with Embossed Polarity Arrow (Polarity side of two finger-Grounding contacts) pointing to Debossed Track polarity line for proper installation.
3. Tighten set screw to lock to track. **NOTE: Track ends must be terminated with either a dead end or a connector.**
   Pull wires from box thru open hole in live end as shown. Fasten track to ceiling following instructions supplied with the track section.
4. Cut and strip wires from box and connect black wire from box to brass screw terminal marked "P". Connect white wire from box to nickel-plated screw terminal marked "N".
5. Fasten ground green wire to the green ground screw. Push excess wire back into outlet. Replace cover on live end and tighten screw.

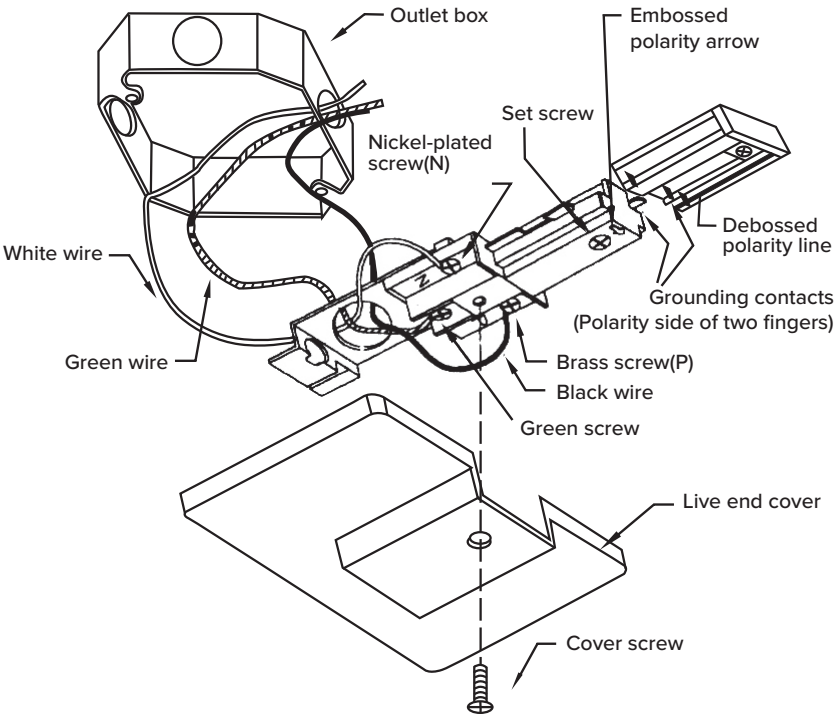

WARNING: TO AVOID THE POTENTIAL RISK OF FIRE AND SHORTING, UNDER ANY CIRCUMSTANCES SHOULD NOT YOU USE THE CONNECTORS AND END CAP WITHOUT BUSBAR STOPPERS (DRAWINGS BELOW WITH "X" MARK) FOR YOUR TRACK SYSTEM.

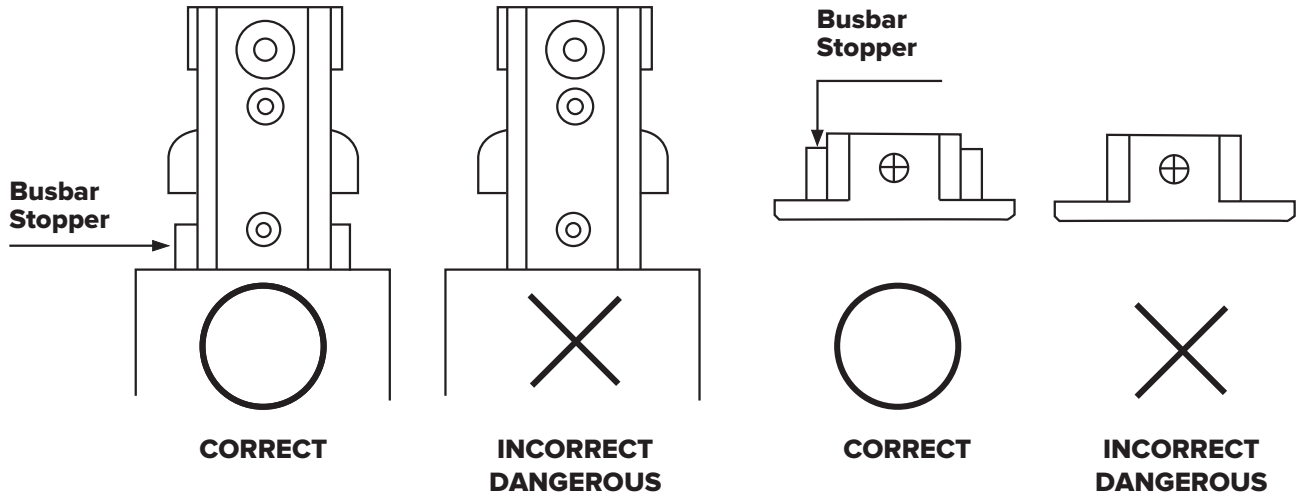

2042 East Vernon Ave. Vernon, CA 90058 • Tel: (323) 231-2600 Fax: (323) 231-3200 www.elcolighting.com

ALL RIGHTS RESERVED © ELCO Lighting 2026